

# CITY OF EDMONTON PROPOSED STANDARDS FOR CRITICAL SWALES

## REAR TO FRONT DRAINAGE

### BACK OF THE LOT

#### OVERALL LOT SLOPE

2-3%

3-6%


GREATER THAN 6%

#### AROUND BUILDING


2m @ 10% MIN. SLOPE  
OR MIN. 0.15m DROP  
IF LESS THAN 1.5 m  
FROM WALL TO  
PROPERTY LINE

#### REAR SWALE


DRAINAGE MAY BE  
SPLIT FROM CENTRE  
OR ALL SLOPED TO  
LOW SIDE.  
(TYPICAL 1.5% MIN.  
CROSS YARD SLOPE)

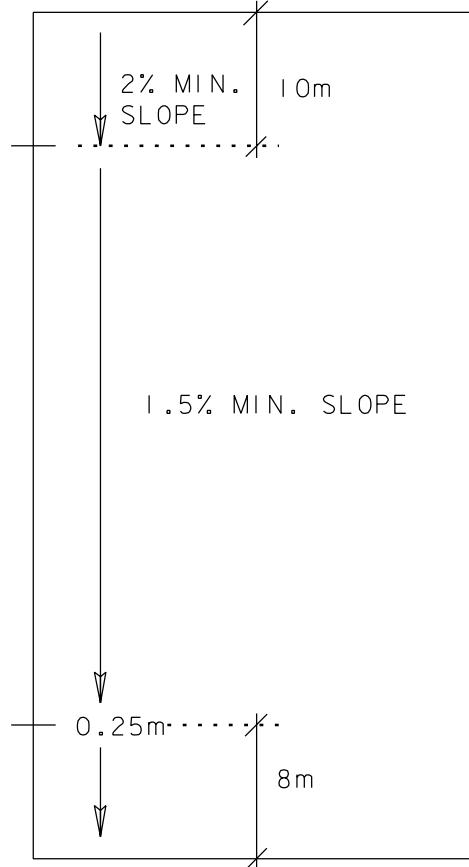

TYPE A

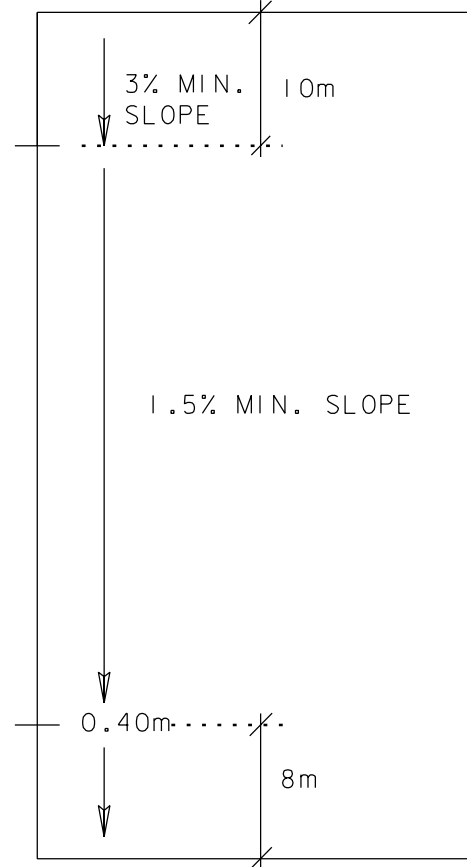

TYPE B

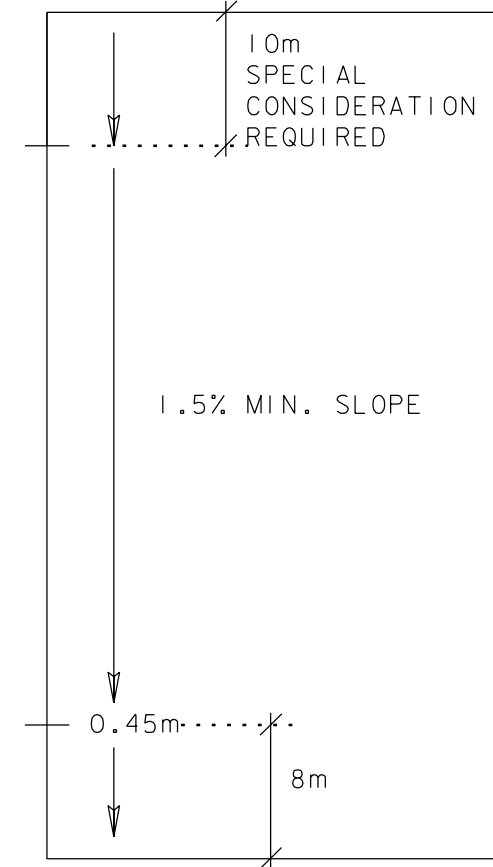

TYPE C

### FRONT OF THE LOT